



Floor Plan

3.06.02 C
Nurses Station-CCU/ICU

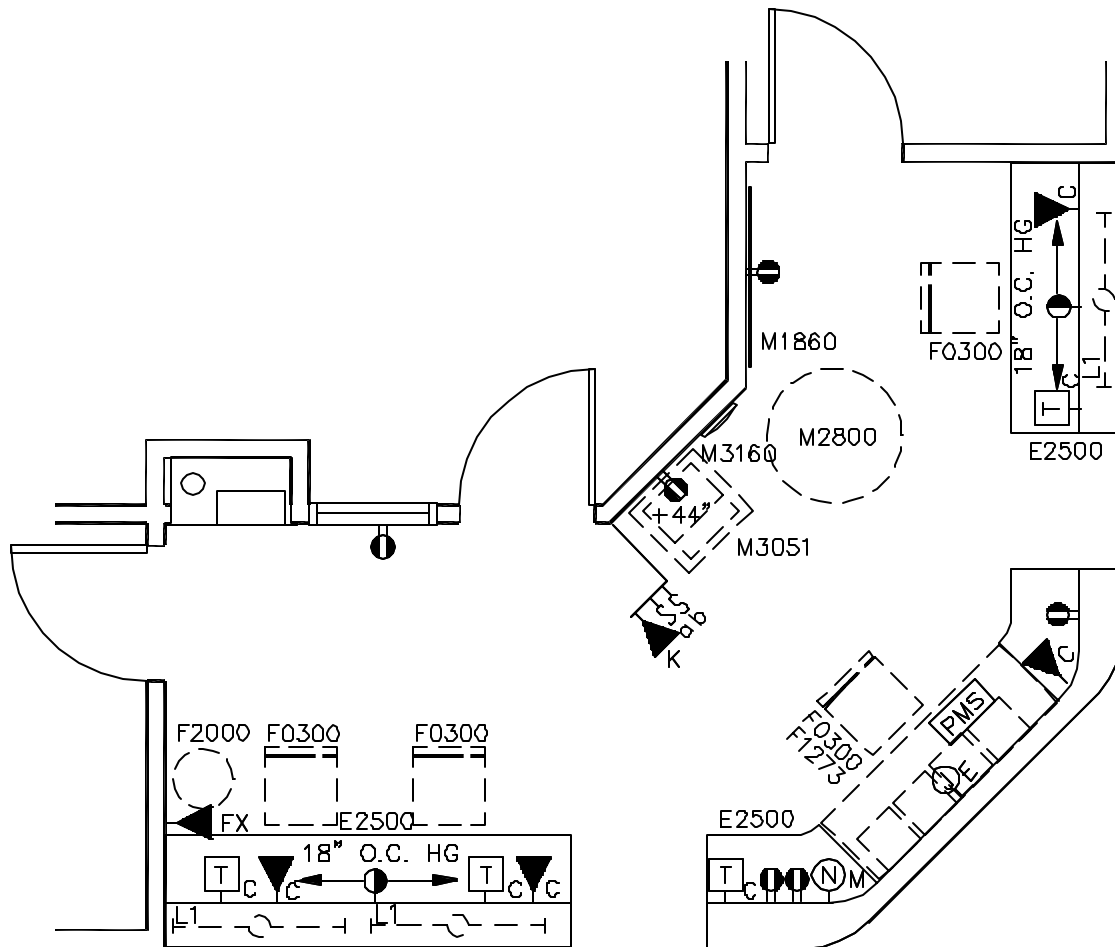


JULY 1988




Reflected Ceiling Plan

Nurses Station—CCU/ICU

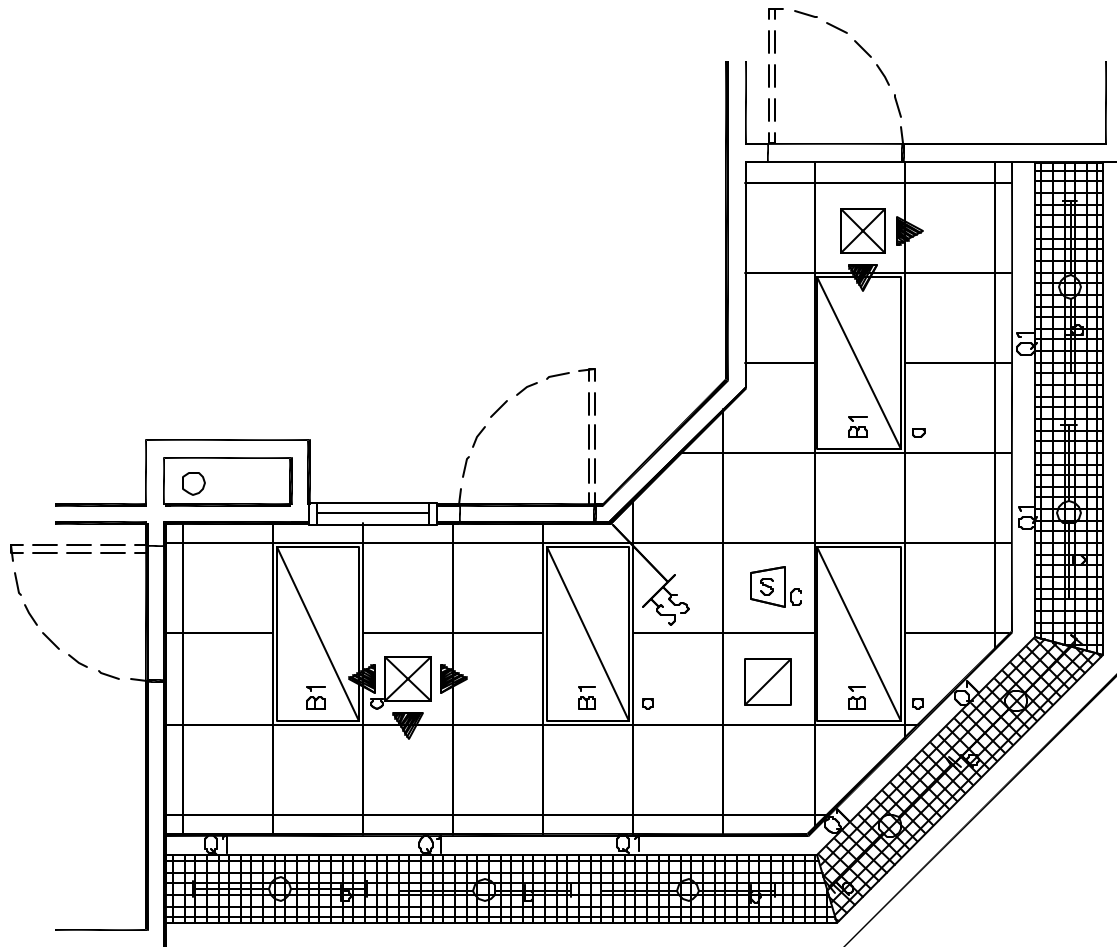


JULY 1988




Functional Diagram

Nurses Station—CCU/ICU

3.06.02 B

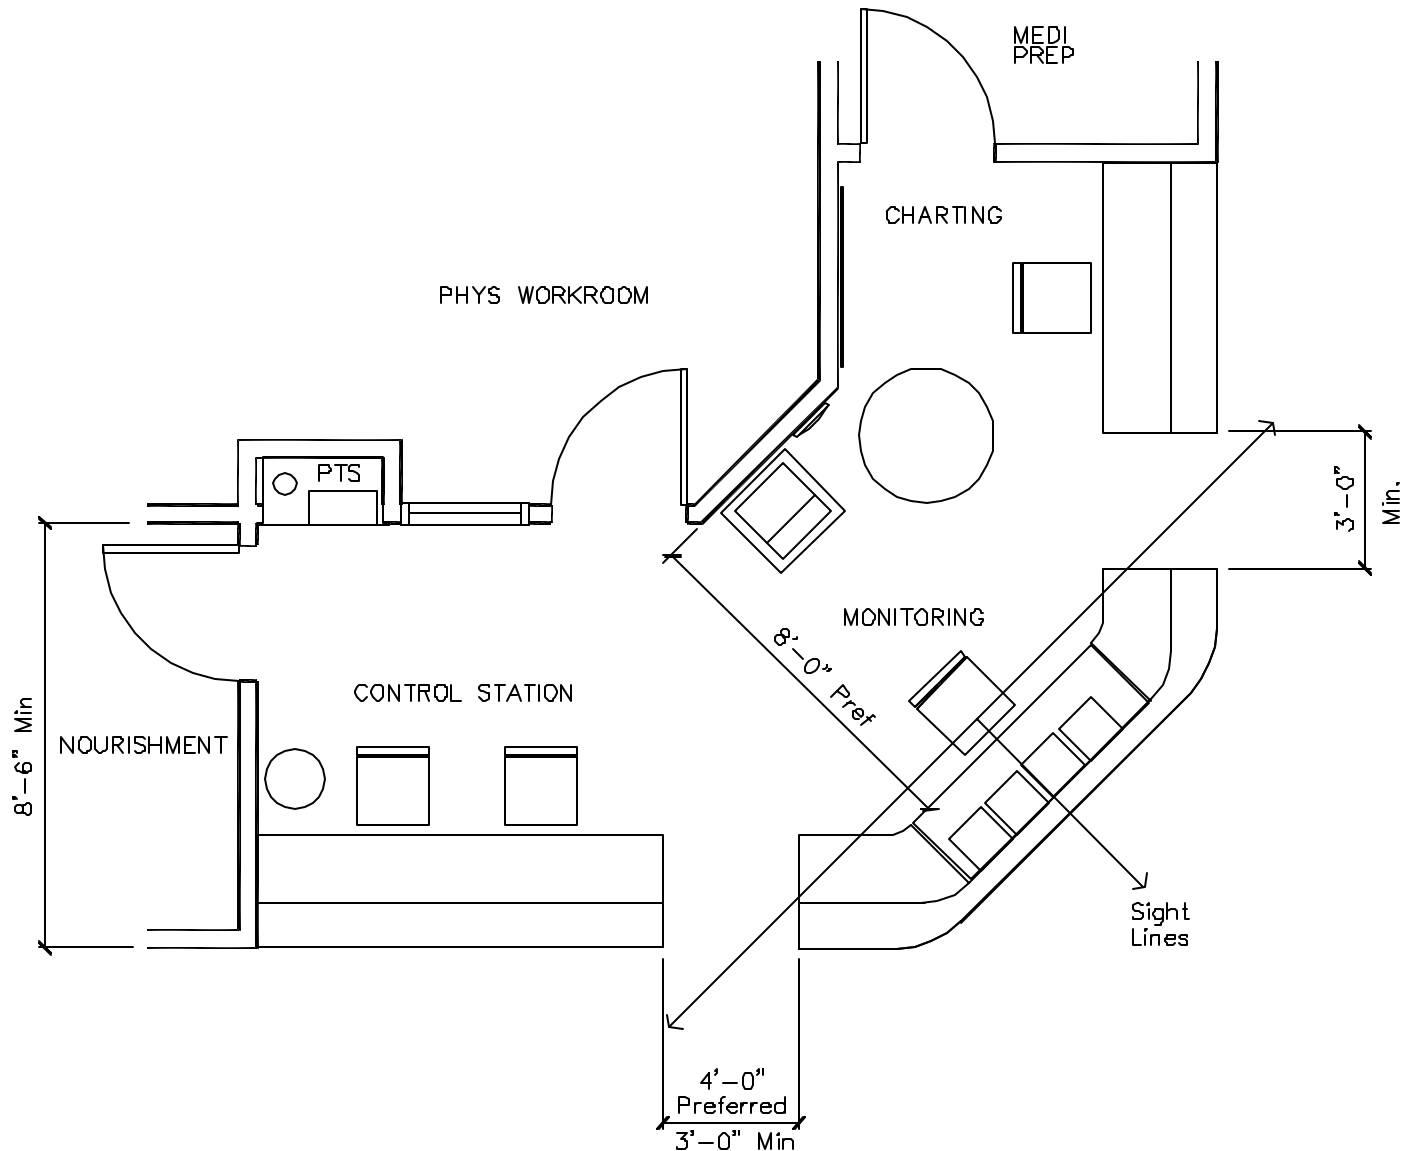


JULY 1988




Composite Plan

3.06.02 E
Nurses Station-CCU/ICU

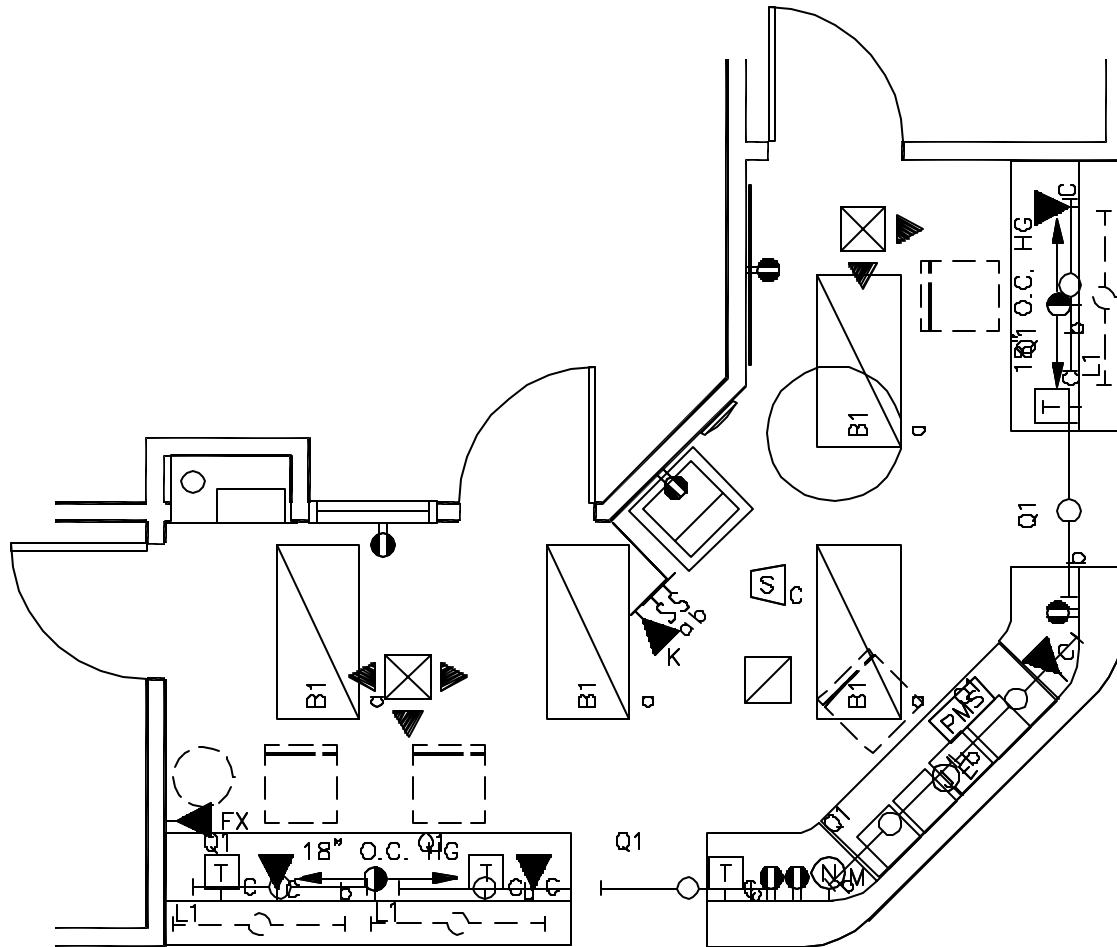

JULY 1988



Matrix Data

3.06.02 A Nurses Station-CCU/ICU

ARCHITECTURAL/ACOUSTICS

Square Foot Area Net	- 250
Finishes	- Walls - GW
	- Base - R
	- Floor - VCT
	- Ceiling - ACT
Ceiling Ht	- 8'-0"
Door Size & Type	-
Hardware Set	-
Ambient Noise Level	- NC 35-40
Speech Privacy Level	- Normal

Architectural Notes - 23,24
ref pp 5-6

ELECTRICAL

Ambient Illum (FC)	- 30
Task Illum (FC)	- 70
Luminare Type	- B1,L1,Q1
Switching	- Std-by Area

Electrical Notes - 33,34
ref pp 20-23

MECHANICAL

Total Air Changes	- 6.0
Outside Air Changes	- 1.5
Room Pressure(%)	- 0
Temperature (F)	- Sum 78 Win 70
Relative Hum(%)	- 30-60
Exhaust Air	- No
Return Air	- Yes
Filtration(%)	- 25,80,0

Mechanical Notes -

MECHANICAL PIPING

Cold Water	- No
Hot Water	- No
Treated Water	- No
Chilled Water	- No
Waste/Vent	- No
Floor Drain	- No
Steam	- No
Condensate	- No

Piping Notes -

EQUIPMENT PROGRAM

J.S.N. Code	Nomenclature	Qty	Log Cat
M1860	Bulletin Board	1	A
M3160	Clock, Electric	1	A
F0300	Chair, Rotary w/o Arms	4	C
F1273	Counter, Central Monitors	1	C
F2000	Waste Receptacle, Off	1	C
M2800	Cart, Chart Holder	1	C
M3051	Defibrillator w/Cart	1	C
E2500	Nurses Station, Modular	2	E

COMMUNICATION PROGRAM

Commo Code	Nomenclature	Qty	Log Cat
NC00M	Master Control Station	1	A
PA00C	Ceiling Speaker	1	A
TL00C	Counter Outlet-6" Above CT	4	A
TL00F	Floor Outlet-Flush	1	A
TL00K	CAPOC Outlet	1	A
TL0FX	Facsimile Outlet	1	A
TS00C	Counter Outlet-6" Above	4	A

Matrix Data

3.06.02 A2
Nurses Station—CCU/ICU
